

Three Mated 2400 Gal. Cisterns

Domestic Potable Water

FLXX®

FLXX®

Installation Instructions:


Excavation should be 8' deep x 15' wide x 25' long. Floor of the excavation should be level with no protruding rocks, and a minimum of 4" of 3/4" rock bed, leveled and compacted to set tanks on. Excavator should provide a safe and clear offloading site within 15' from the rear of the truck to the center of the tank. Selected (6" minus) granular backfill should be rolled in from the side in equal lifts around the tank and compacted. Avoid dumping directly on the lids of the tanks.

Note:

Other mated cistern configurations are available. Contact FRPC sales for details.



Four mated 3600 gal. cisterns (14,400g total) for agricultural use.

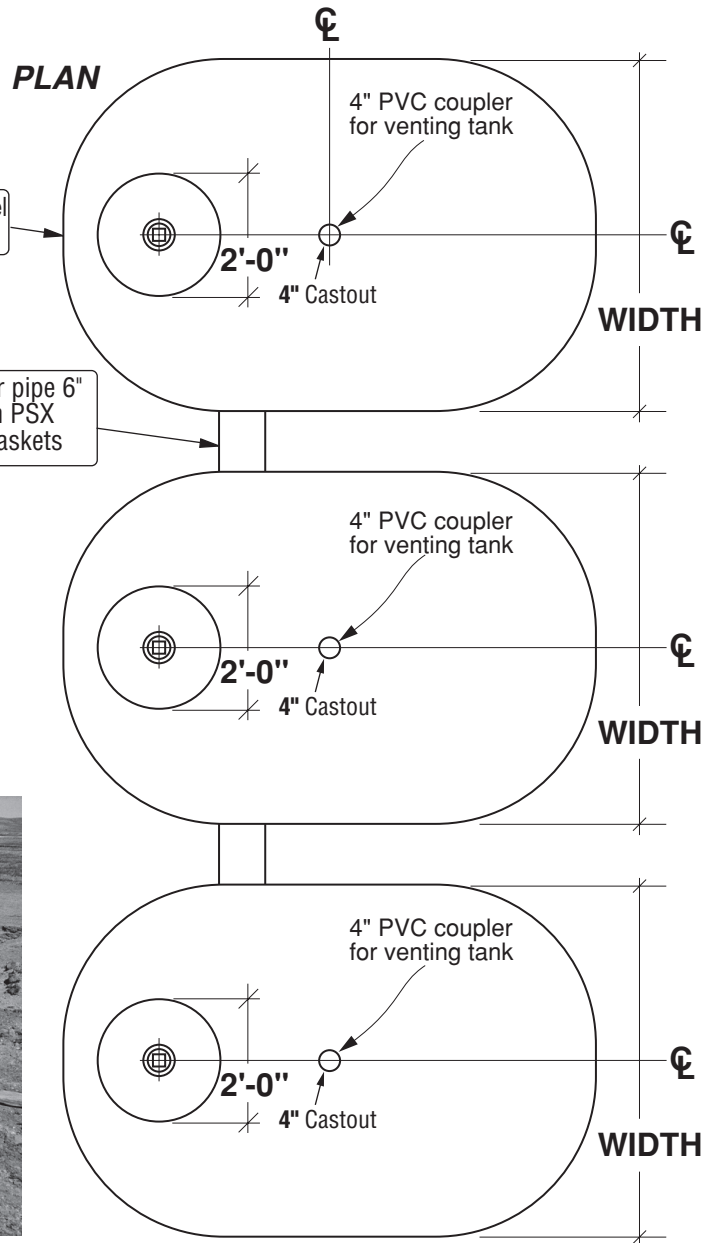

Note: N.T.S.

Revised July 2016

FLXX® 
Watertight
Front Range Precast Concrete, Inc.
 5901 Dexter Street, Unit 200, Commerce City, CO 80022
 Phone (303) 442-3207 • (800) 783-3207 • Fax (303) 442-3209
www.flxx.com